


**NOTES:**

1. P.V.C. PIPE WITHIN MANHOLE SHALL BE SDR-35.
2. MANHOLE MAY BE EITHER PRECAST OR MONOLITHIC TYPE.
3.  $\bar{E}$  OF SURCHARGE LINE NORMALLY PLACED AT TOP OF EXISTING WASTEWATER LINE UNLESS NOTED OTHERWISE ON PLANS.

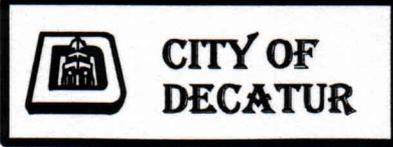

SEWER SYSTEM CONSTRUCTION DETAILS  
**DROP SANITARY SEWER  
 MANHOLE**

REVISED MAR 2000  
 SCALE: 1/2" = 1'  
 SHEET: **S-4**