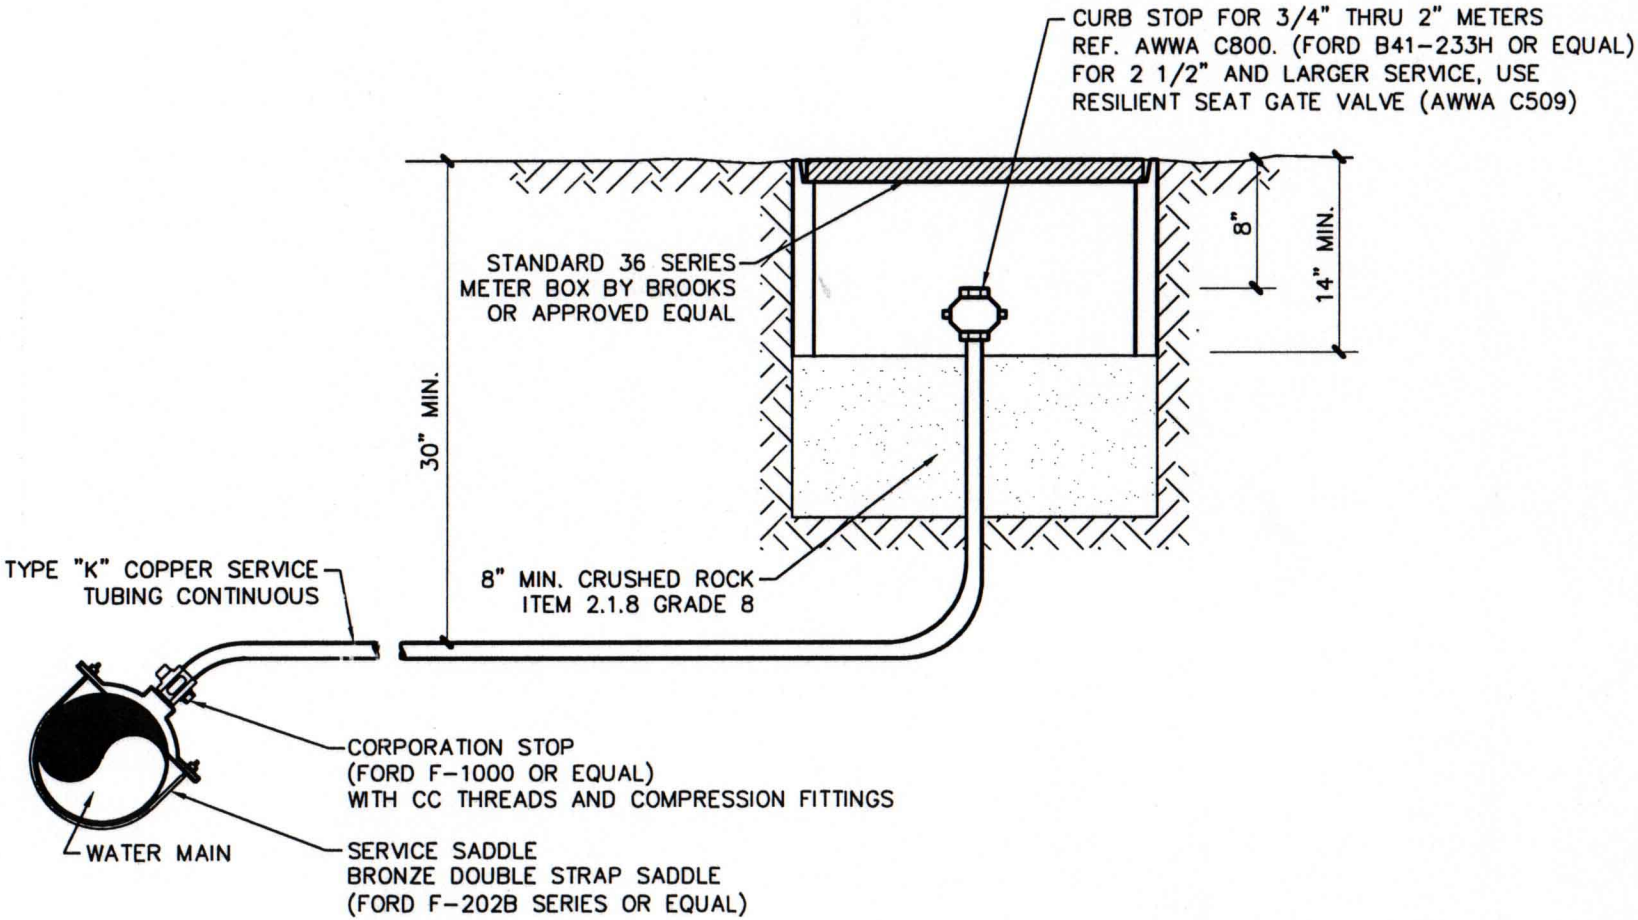

NOTES:

1. SERVICE SADDLE AND CORPORATION STOP SHALL BE PER WATER SERVICE ASSEMBLY.

CITY OF DECATUR

WATER SYSTEM CONSTRUCTION DETAILS

FLUSHING VALVE INSTALLATION

REVISED MAR 2000

SCALE: 1" = 1'

SHEET: W-6